

Project Commissioning Progress

Test Ref	Mechanical & Public Health Systems	Task % Complete	Stage 1 Testing	Stage 2 Testing	Stage 3 Testing	Stage 4 Testing	Stage 5 Testing
M1	Primary Air	75%	100%	75%	0%	50%	0%
M2	Secondary Air	50%	100%	0%	0%	50%	0%
M3	Toilet Extract	53%	100%	0%	0%	60%	0%
M4	Air Handling Unit	22%	65%	0%	0%	0%	0%
M5	Critical Chilled Water - CCHW	63%	100%	75%	50%	25%	0%
M6	Domestic Water - BCWS & HWS	51%	85%	67%	0%	0%	0%
M7	CRAC Units	12%	58%	0%	0%	0%	0%
M8	Condensate	70%	94%	45%	0%	NA	0%
M9	Leak Detection	17%	50%	0%	0%	0%	0%
M10	Fire Dampers	27%	34%	20%	0%	0%	0%
M11	Motorised Dampers	21%	62%	0%	0%	0%	0%
M12	Trace Heating	2%	5%	0%	0%	0%	0%
M13	Drainage - SVP	2%	4%	0%	0%	0%	0%
M14	CHW	34%	67%	0%	0%	0%	NA
		Totals	66%	20%	4%	14%	0%




Project:	
Main Contractor	
Contractor	
Produced By	
Revision	
Date	6/25/2026

Mechanical, Electrical & Public Health Commissioning Progress



Project Commissioning Progress

Commissioning Progress Monthly Notes

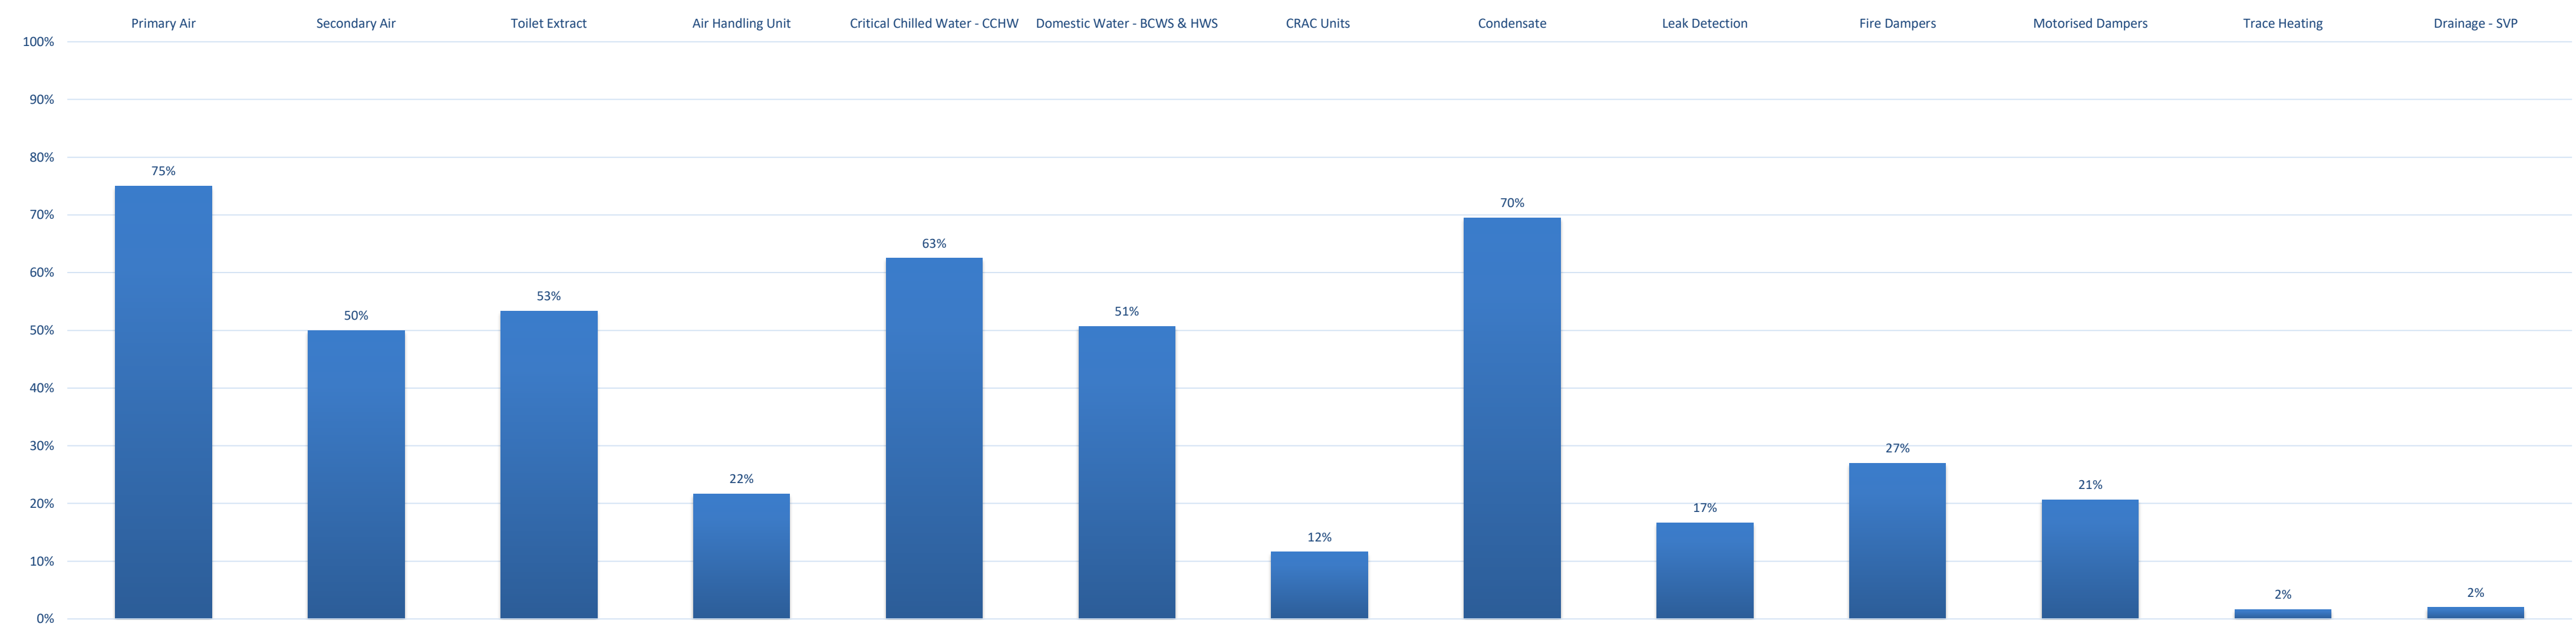

Date 6/25/2026

Test Ref.	Area Located	Level 1	Level 2	Level 3	Level 4	Level 5	Comments
		Witnessed	Witnessed	Witnessed	Witnessed	Witnessed	
Primary Air		0%	0%	0%	0%	0%	
Primary Air L1	Level 1						
Secondary Air		0%	0%	0%	0%	0%	
Secondary Air - Level 1	Level 1						
Toilet Extract		0%	0%	0%	0%	0%	
Toilet Extract - Level 1	Level 1						
Air Handling Unit		0%	0%	0%	0%	0%	
AHU-01-01	Level 1						
Fans		0%	0%	0%	0%	0%	
EF-01-01	Level 1						
Critical Chilled Water - CCHW		0%	0%	0%	0%	0%	
CCHW - Level 1	Level 1						
Domestic Water - BCWS & HWS		0%	0%	0%	0%	0%	
Domestic Water - Level 1	Level 1						
CRAC Units		0%	0%	0%	0%	0%	
CRAC/01/01	Level 1						
Condensate		0%	0%	0%	0%	0%	
Condensate - Level 1	Level 1						
Leak Detection		0%	0%	0%	0%	0%	
LD-01-01	Level 1						
Fire Dampers		0%	0%	0%	0%	0%	
Fire Dampers - Level 1	Level 1						
Motorised Dampers		0%	0%	0%	0%	0%	
MSFDs - Level 1	Level 1						
Trace Heating		0%	0%	0%	0%	0%	
Trace Heating - Level 1	Level 1						
Drainage - SVP		0%	0%	0%	0%	0%	
SVPs - Level 1	Level 1						
Chilled Water - CHW		0%	0%	0%	0%	0%	
CHW - Level 1	Level 1						
Primary Air							
Secondary Air							
Toilet Extract							
Air Handling Unit							
Fans							
Critical Chilled Water - CCHW							
Domestic Water - BCWS & HWS							
CRAC Units							
Condensate							
Leak Detection							
Fire Dampers							
Motorised Dampers							